


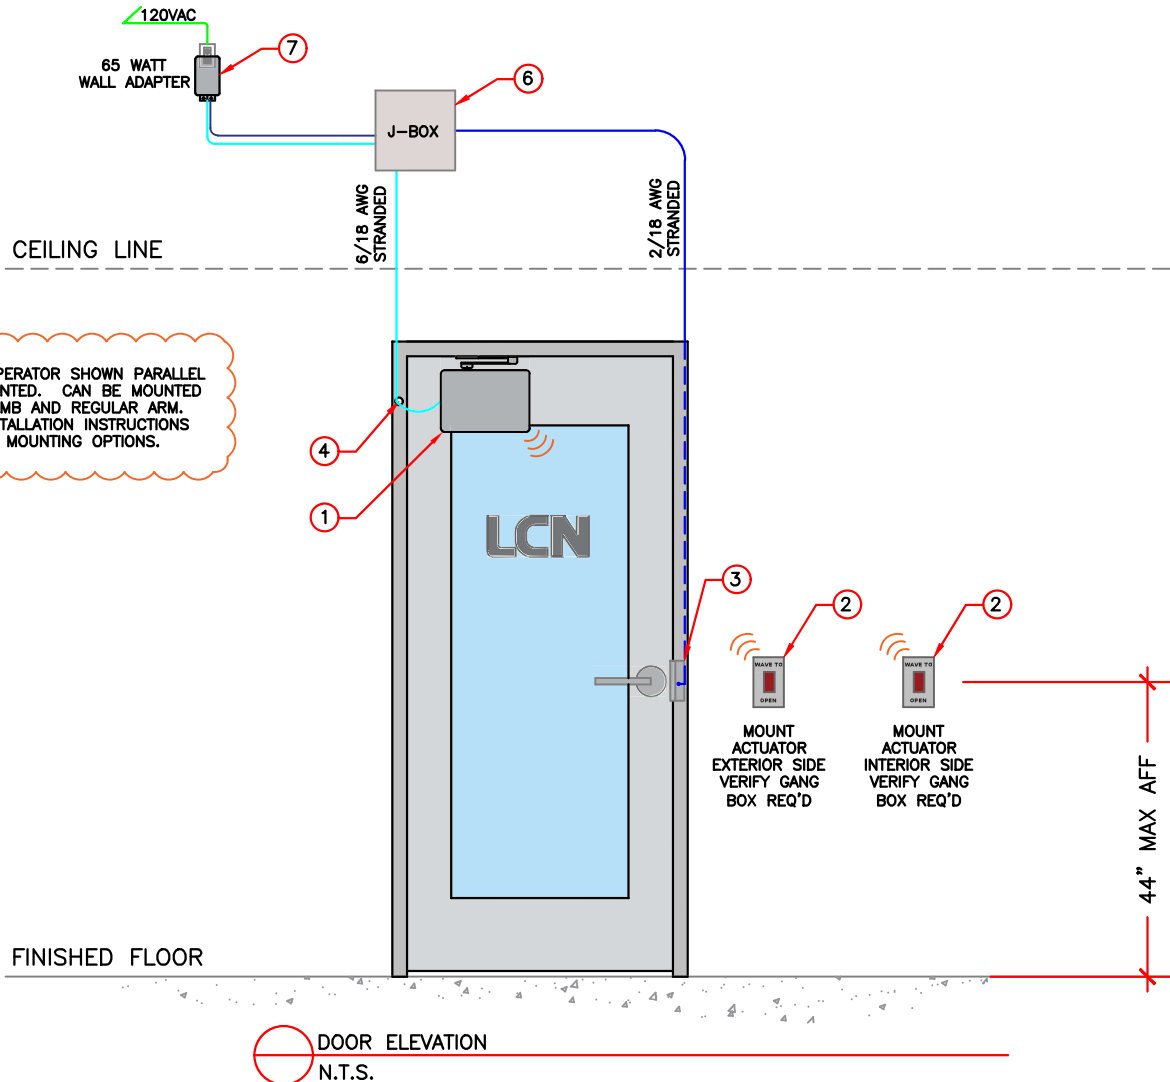

HARDWARE CHECKLIST		
	DESCRIPTION	PART NUMBER
①	LCN AUTOMATIC OPERATOR	LCN 6440 AUTO OPERATOR
②	TOUCHLESS ACTUATOR	LCN 8310-2210 (BATTERY / RF SIGNAL)
③	ELECTRIC STRIKE (FAIL SECURE)	LOCKNETICS NC450 OR CS450/750 ELEC STRIKE
④	DOOR LOOP	INCLUDED WITH LCN 6440
⑤	CYLINDRICAL PASSAGE SET	SCHLAGE OR FALCON AS REQUIRED
⑥	DELAY SEQUENCER	LCN 8310-845 (MOUNT IN J-BOX)
⑦	65 WATT POWER SUPPLY	LCN 6400-471 (ORDERED SEPARATELY)

GENERAL NOTES:

ALL LOW VOLTAGE WIRE TO RUN IN MINIMUM 3/8" CONDUIT OR INSIDE DRYWALL UNLESS NOTED OTHERWISE
 ALL LOW VOLTAGE WIRE TO BE STRANDED WIRE
 ALL GANG BOXES BY ELECTRICAL CONTRACTOR AS REQUIRED
 ALL LOW VOLTAGE WIRING TO BE LABELED CLEARLY AT BOTH END
 ALL MOUNTING HEIGHTS AS SHOWN
 COORDINATE MOUNTING LOCATIONS WITH ELECTRICAL/ARCHITECTURAL PLANS

OPERATIONAL DESCRIPTION:

DOOR NORMALLY CLOSED AND UNLOCKED.
 INTERIOR OR EXTERIOR ACTUATOR TO START OPENING CYCLE OF AUTOMATIC OPERATOR
 PASSAGE SETS ALLOWS FREE ENTRY AT ALL TIMES
 FREE EGRESS AT ALL TIMES.

 ALLEGIION™ ELECTRIFIED ELEVATION DRAWINGS		DRAWING: ELEVATION DRAWING	
		Drawn By: Jason Relyea DHT, DHC	Checked by:
DATE: 02.02.2023	VERSION: 2	6440-04A	
SCALE: N.T.S.	REVISION: 04.15.2025		
Wiring Diagram Terms of Use: This information is for professional use only and is intended to be a guide for proper product application and specification. See specific product manuals for proper installation. Any installation should be performed by persons qualified to perform electrical work and in compliance with applicable codes, rules, regulations and orders. Allegion reserves the right to change or modify the information herein without notice. No warranties, express or implied, are provided by Allegion as a result of this information. Any and all use and reproduction of the information herein except for product application and specification is expressly forbidden.			
Copyright 2023 Schlage Lock Company LLC.			

