

PS902




Power Supply Installation Instructions

A DANGER A

To avoid risk of electric shock, turn off AC power before installing or servicing PS902 power supply

These instructions cover the following parts:

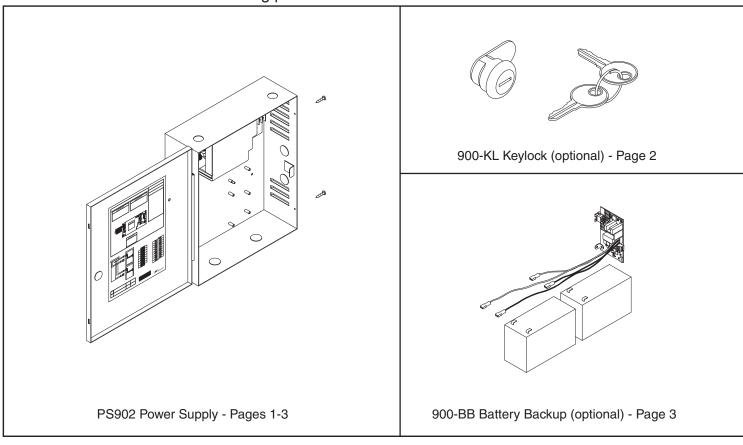

PS902 Power Supply Specifications:

Input	120/240 VAC, 1.1 A, 50/60Hz, High Voltage Class 1 Wiring Required	
Output	2 Amp DC @ 12/24 VDC	
Enclosure	14" H x 12" W x 4" D (8 knockouts, 1/2" or 3/4")	
Temperature Range	32°-120° F (0°- 49° C)	
Fuse	F1, T3.15A	A CAUTION A
	250VAC	For protection against risk of fire, replace fuse with same type and rating
Compliance	UL 294, ULC-S318, RoHS, & FCC Part 15, Class 2 Output	
Compatible Boards	900-2RS	INST. INSTRUCTIONS - 24125007
(Optional, 1 board maximum)	900-2Q	INST. INSTRUCTIONS - 44487098
	900-4R	INST. INSTRUCTIONS - 44487106
	900-4RL	INST. INSTRUCTIONS - 44487080
	900-8F	INST. INSTRUCTIONS - 44487106
	900-8P	INST. INSTRUCTIONS - 44487106
Fire Alarm Input Board (Optional)	900-FA	INST. INSTRUCTIONS - 44487072
Battery Backup Board (Optional)	900-BB	INST. INSTRUCTIONS - 44487064

Mounting notes

The PS902 must be installed in accordance with the article 760 of the National Electrical Code or NFPA 72, Canadian Electrical Code, or any other applicable codes.


Install the PS902 indoors within the protected premises.

Check national and local codes for additional installation requirements.


Enclosure must be firmly mounted to a solid surface using hardware suitable for the surface.

1 Mount power supply

1a Mark 2 Top Holes




1b Secure Enclosure with 4 Screws



2 Secure enclosure door

If No Keylock


Enclosure will be secured with 2 screws as shown (done as last step)




If Keylock

OR


Remove knockout and insert key cylinder, then slide in clip

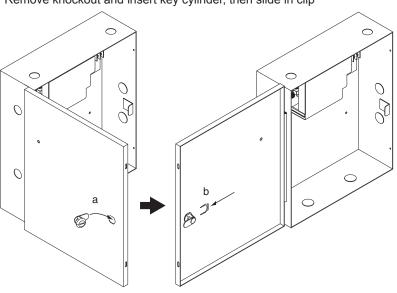

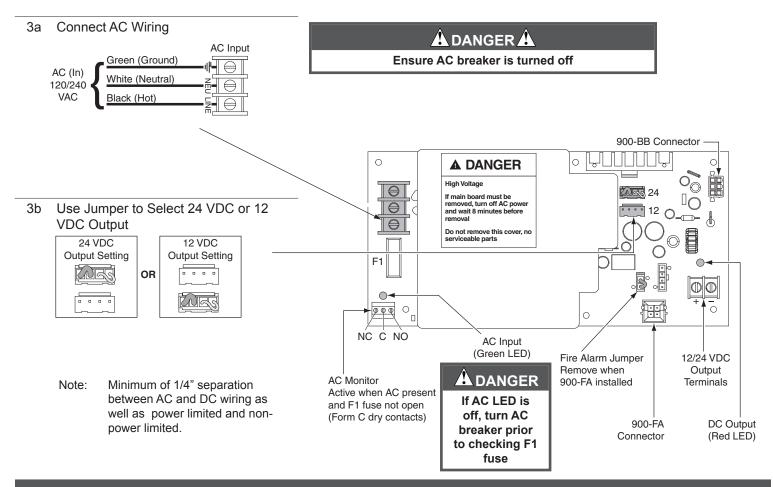

4 Install 900-BB battery backup (If Included)


Refer to 900-BB instructions for additional info

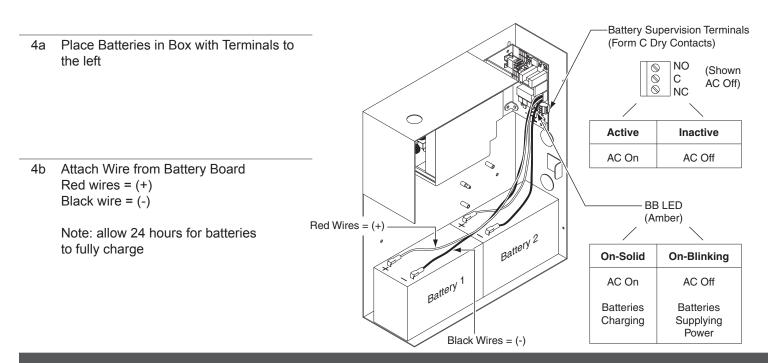


5 Turn on AC breaker to test power supply

- · Verify AC LED is On = GREEN
- Verify DC LED is On = RED
- Verify BB LED (if applicable) is On = AMBER


Terminal Definitions



One 900-FA Board - Automatic Reset




One 900-FA Board - Manual Reset




Fire Alarm Contact Closed = no fire Open = fire Note: If FA is installed on PS902:

- Verify jumper J13 is removed
- Power will be removed from PS902 when fire alarm is active




Option Boards


Refer to appropriate instructions if any board shown below is factory-installed

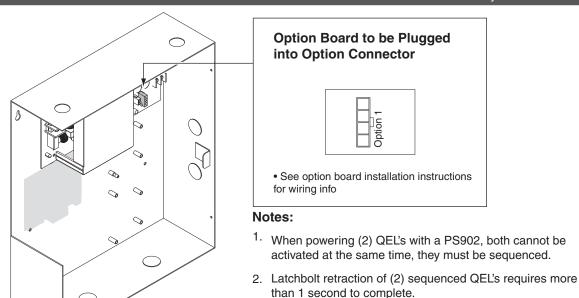



Available option boards:


3. For double door QEL applications with auto operators, it is recommended to use a PS904, 906, or 914 power supply.














(8 Zone Distribution-fuse)

900-8P (8 Zone Distribution-PTC)

NOTE: When installation is complete, secure enclosure door with screws (provided) or keylock

